


THIS DRAWING HAS BEEN PRODUCED FOR LICENSING PURPOSES ONLY



GROUND FLOOR AND SITE PLAN

- Fire Station - Staff
- Intently-Illuminated: "Staff" sign with letters of Yellow Illuminum Night, highly visible, specified and provided with strictly from local codes and emergency lighting society, with dualized sign above appropriate.
- Non-Activated Maintenance: (Program only, not accepted)
- Area Covered By Emergency Lighting System: (Program only, not accepted)
- Not-Maintained, Not-Included In Maintenance:
- Fire alarm call point
- Audible Warning Device
- Heat Detector - Fixed Temperature
- Smoke Detector - Optical
- Fire Alarm Indicator Panel
- Fire Extinguishers, water type, minimum size 5 liters
- Fire Extinguishers, dry powder type, minimum size 2.5kg
- Fire Blanket, minimum size 1.2m x 1.2m

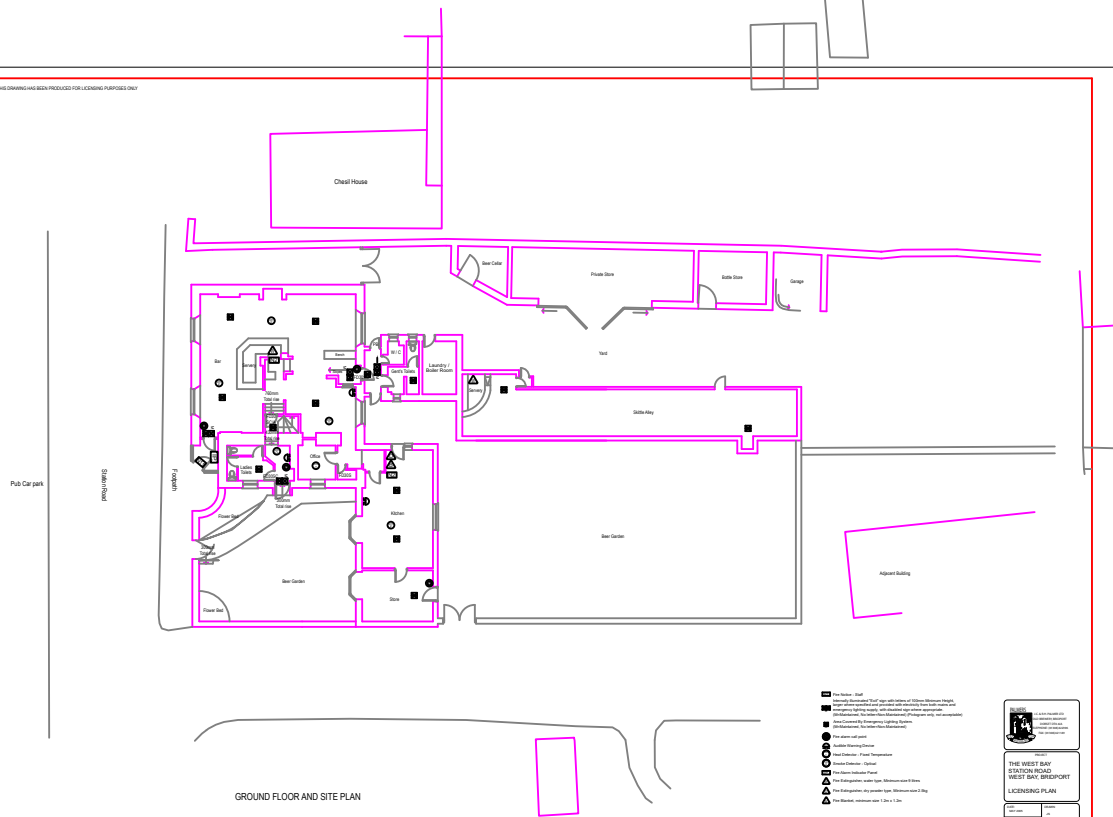